
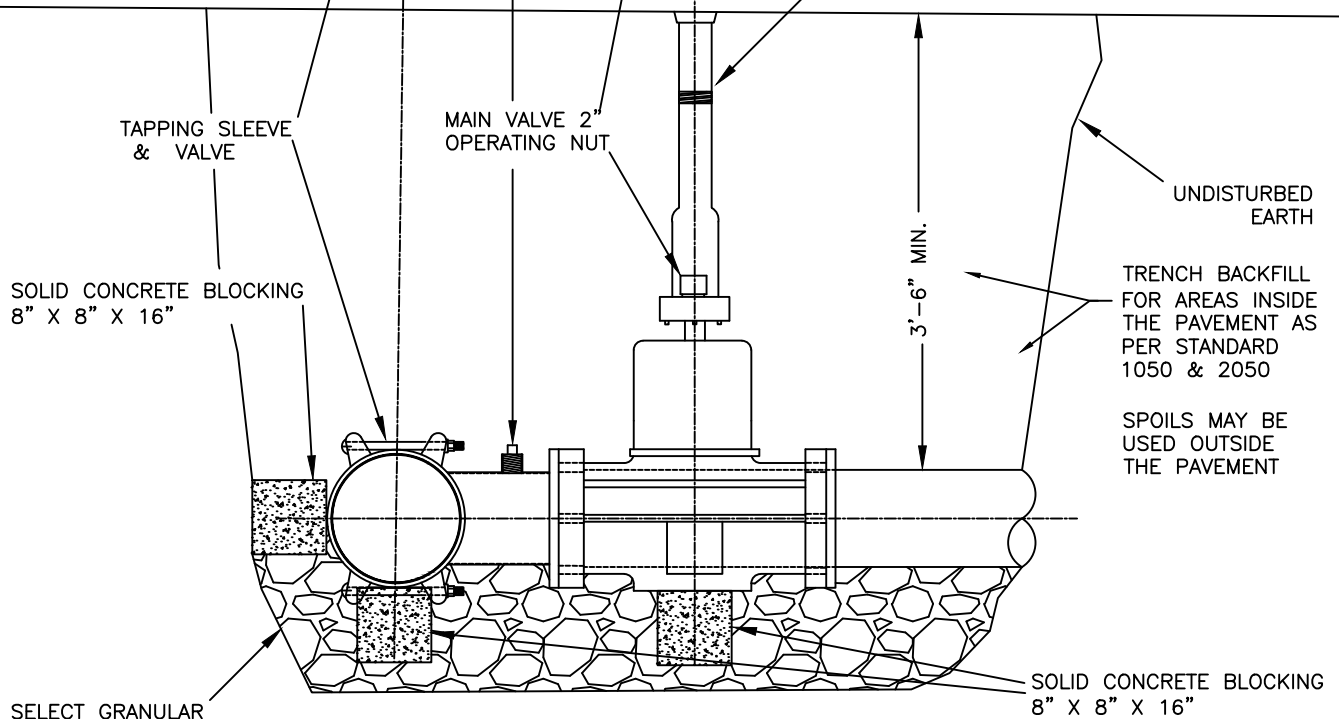


STANDARD DESIGN WATERMAIN TAPPING SLEEVE AND VALVES

PLAN

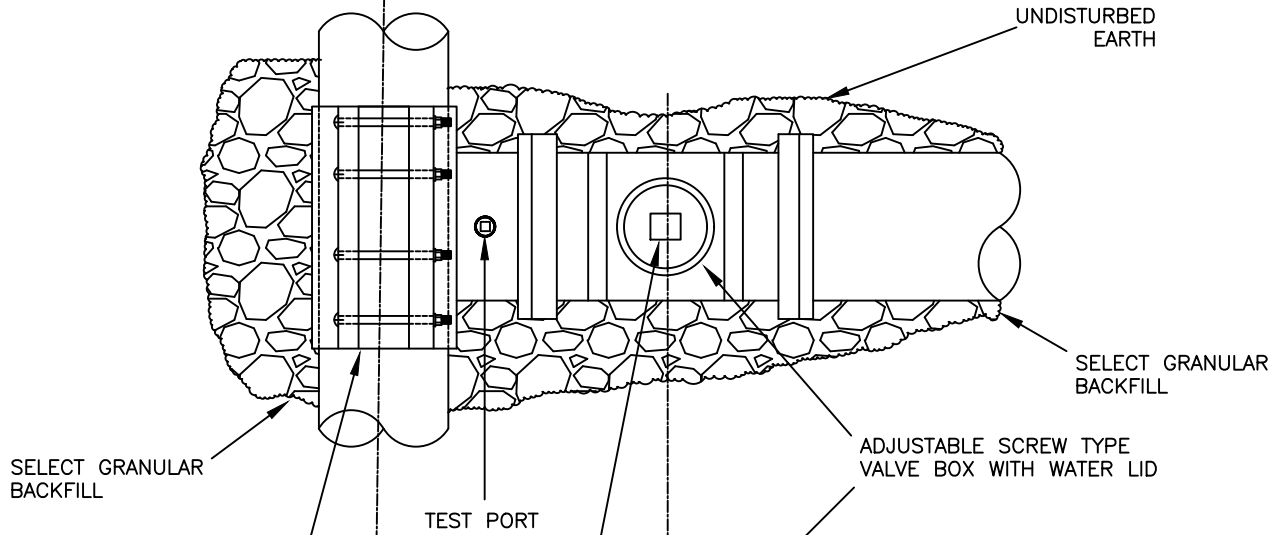

ELEVATION

NOTES:

1. FOR SIZES 4" TO 12" GATE VALVE SHALL BE MUELLER A-2362-19 DUCTILE IRON, OPEN RIGHT, MJ X FL.
2. POLYWRAP ALL FITTINGS AND PIPE.
3. INSTALL POLY WRAP OVER BONNET BOLTS ON THE VALVE.

STANDARD #4005

CITY OF DECATUR, ILLINOIS
WATER MANAGEMENT
DEPARTMENT

ADOPTED JANUARY 6, 2023

[Signature]
DIRECTOR OF PUBLIC WORKS

ISSUED: 1/6/23

REVISIONS	
BY	DATE
KEZ	1/6/23