


# STANDARD DESIGN WATERMAIN VALVES 16" & LARGER

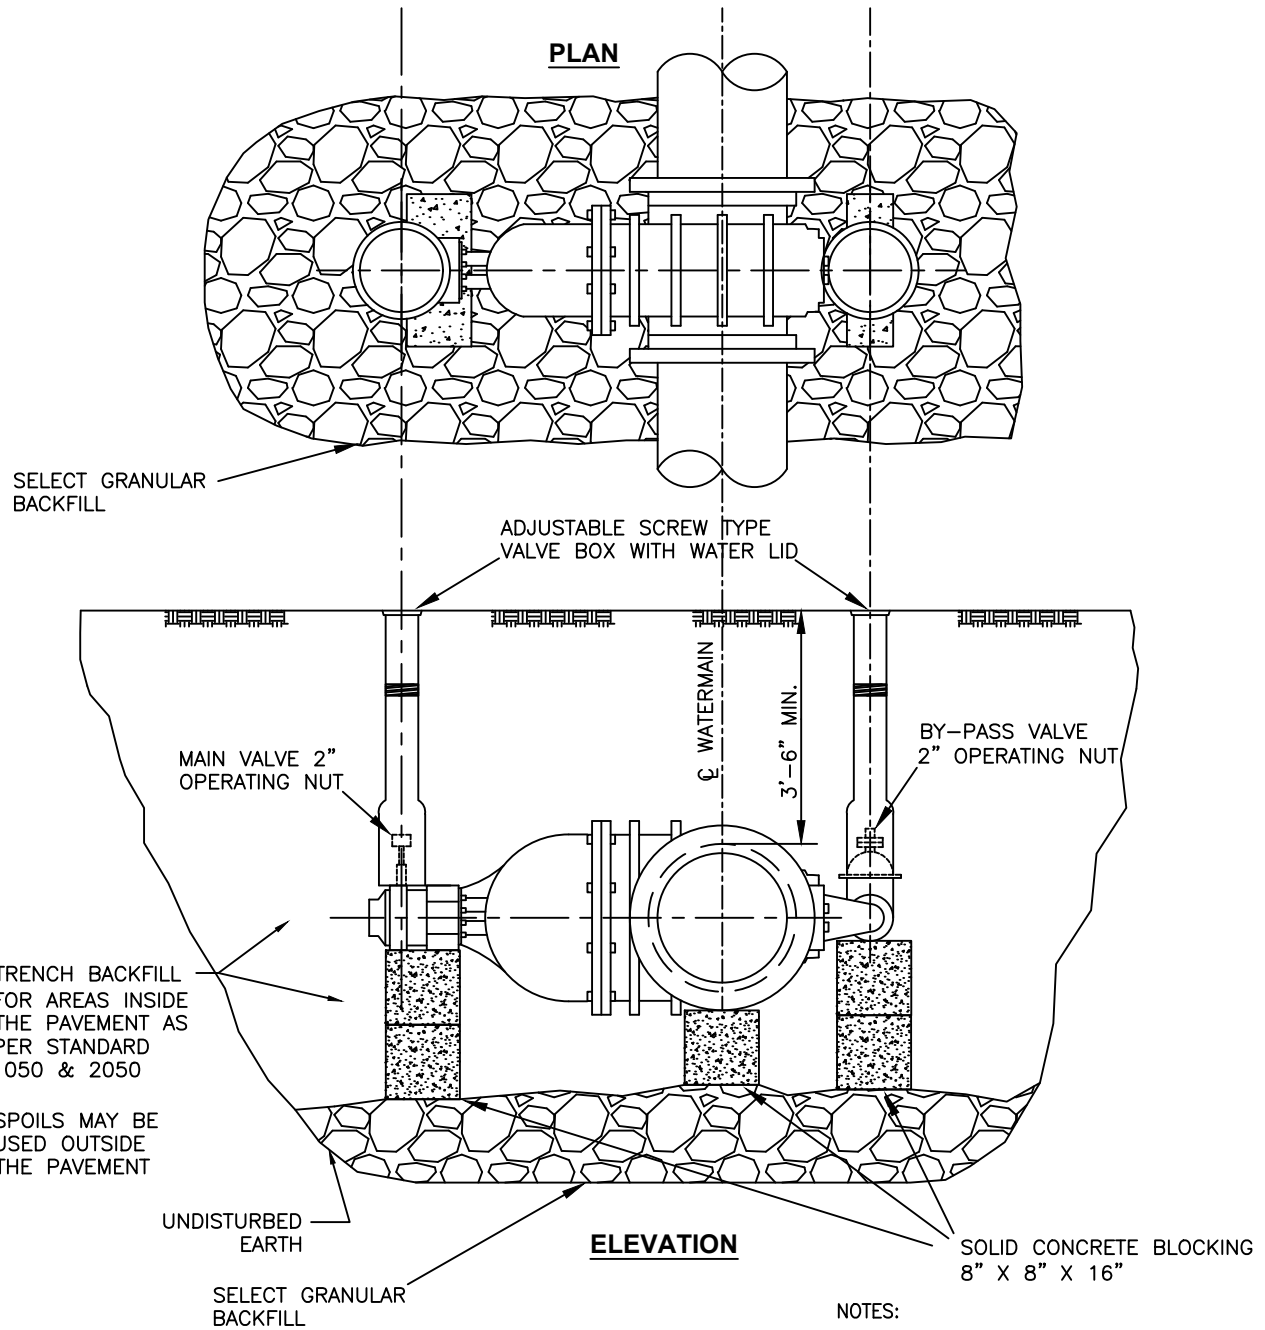

**NOTES:**

1. FOR SIZES 16" TO 48" GATE VALVE SHALL BE MUELLER A-2361-23 DUCTILE IRON RESILIENT WEDGE OPEN RIGHT, MJ X MJ.
2. VALVES SHALL BE COMPLETE WITH MUELLER BEVEL GEARING VALVE OPERATOR.
3. BY-PASS VALVE REQUIRED FOR VALVES 16" AND LARGER.
4. POLYWRAP ALL FITTINGS AND PIPE.
5. INSTALL POLYWRAP OVER BONNET BOLTS ON THE VALVE.

STANDARD #4010

CITY OF DECATUR, ILLINOIS  
WATER MANAGEMENT  
DEPARTMENT

ADOPTED JANUARY 6, 2023

*[Signature]*  
DIRECTOR OF PUBLIC WORKS

ISSUED: 1/6/23

| REVISIONS |          |
|-----------|----------|
| BY        | DATE     |
| F.W.T.    | 12/15/81 |
| SHOF      | 9/15/89  |
| R.W.D     | 4/9/97   |
| RNB       | 12/19/02 |
| KEZ       | 1/6/23   |