



STANDARD DESIGN INSTALLATION TYPICAL DOMESTIC WATER SERVICE

PLAN

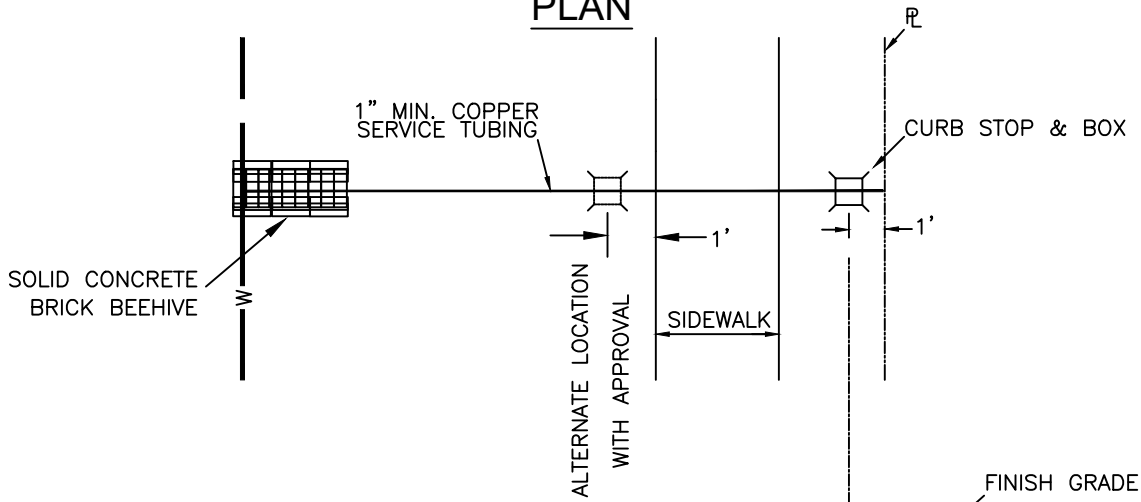

PROFILE

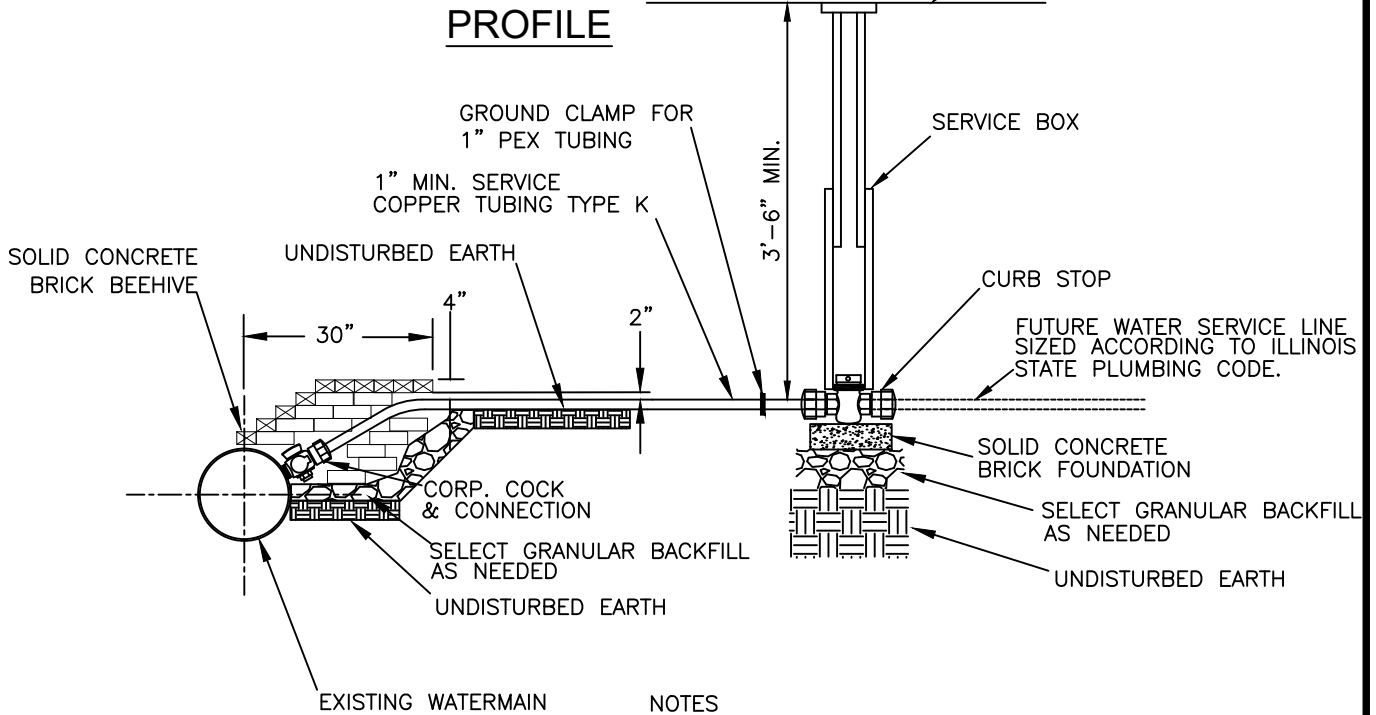

NOTES

1. CORPORATION COCK SHALL BE MUELLER #H-15008N OR APPROVED EQUAL.
2. CURB STOP SHALL BE MUELLER #H-15155N OR APPROVED EQUAL.
3. SERVICE BOX SHALL BE #H-10300 OR APPROVED EQUAL.
4. WATER SERVICE SHALL CONFORM TO CITY CODE CHAPTERS 64 & 75.
5. TAP WATER MAIN AT 45° TO 90°. (9 TO 10, 2 TO 3 POSITION)
6. HOUSE SERVICE 1" BLUE PEX (200 PSI) W/12 GA. TRACER WIRE OR 1" K COPPER

CITY OF DECATUR, ILLINOIS
WATER MANAGEMENT
DEPARTMENT

ADOPTED JANUARY 6, 2023

[Signature]
DIRECTOR OF PUBLIC WORKS

ISSUED: 1/6/23

REVISIONS

| BY | DATE |
|------|--------|
| SHOE | 1/2/90 |
| RNB | 1/1/02 |
| KEZ | 1/6/23 |
| | |
| | |

SHOE 1/2/90

RNB 1/1/02

KEZ 1/6/23

STANDARD#4040